


PLAN VIEW B-B



ELEVATION A-A



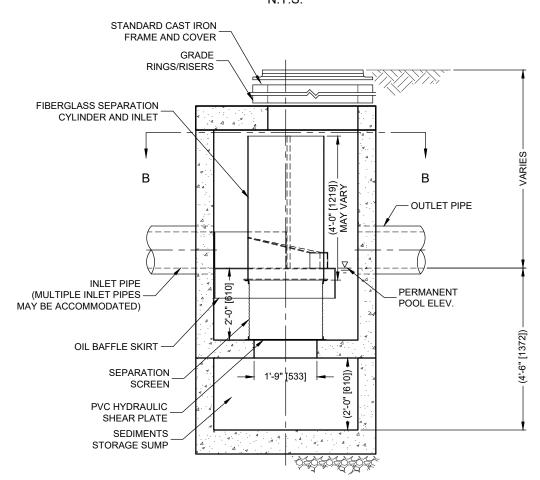

CWNTECH* ENGINEERED SOLUTIONS LLC www.ContechES.com 9025 Centre Pointe Dr., Suite 400, West Chester, OH 45069

800-338-1122 513-645-7000 513-645-7993 FAX

 SCREEN APERTURE (2400)
 *

 PIPE DATA:
 I.E.
 MATERIAL
 DIAMETER

 INLET PIPE 1
 *
 *
 *

 INLET PIPE 2
 *
 *
 *

 OUTLET PIPE
 *
 *
 *

HEIGHT

SITE SPECIFIC

DATA REQUIREMENTS

RIM ELEVATION

ANTI-FLOTATION BALLAST | WIDTH

NOTES/SPECIAL REQUIREMENTS:

WATER QUALITY FLOW RATE (L/s)

RETURN PERIOD OF PEAK FLOW (YRS)

* PER ENGINEER OF RECORD

STRUCTURE ID

PEAK FLOW RATE (L/s)

SOLENO TO PROVIDE ALL MATERIALS UNLESS NOTED OTHERWISE.

CONTECH

FRAME AND COVER (DIAMETER VARIES)

STANDARD CDS-4-C (CDS2015-4) CONFIGURATION.

- 2. FOR SITE SPECIFIC DRAWINGS WITH DETAILED STRUCTURE DIMENSIONS AND WEIGHT, PLEASE CONTACT YOUR SOLENO ENGINEER
- 3. CDS WATER QUALITY STRUCTURE SHALL BE IN ACCORDANCE WITH ALL DESIGN DATA AND INFORMATION CONTAINED IN THIS DRAWING. CONTRACTOR TO CONFIRM STRUCTURE MEETS REQUIREMENTS OF PROJECT.
- 4. STRUCTURE SHALL MEET CL-625 LOAD RATING (CAN/CSA-S6), ASSUMING EARTH COVER OF 300 MM (12')', AND GROUNDWATER ELEVATION AT, OR BELOW, THE OUTLET PIPE INVERT ELEVATION. ENGINEER OF RECORD TO CONFIRM ACTUAL GROUNDWATER ELEVATION. BNQ2622-420 IDENTIFICATION AND THE CONTECH LOGO WILL BE STAMPED ON EACH PART OF THE PRECAST CONCRETE STRUCTURE.

DESIGN NOTES: CDS-4-C (CDS2015-4)

- 5. IF REQUIRED, PVC HYDRAULIC SHEAR PLATE IS PLACED ON SHELF AT BOTTOM OF SCREEN CYLINDER. REMOVE AND REPLACE AS NECESSARY DURING MAINTENANCE CLEANING.
- 6. CDS STRUCTURE SHALL BE PRECAST CONCRETE CONFORMING TO BNQ3622-420 AND BNQ 1809-300.

INSTALLATION NOTES

- A. ANY SUB-BASE, BACKFILL DEPTH, AND/OR ANTI-FLOTATION PROVISIONS ARE SITE-SPECIFIC DESIGN CONSIDERATIONS AND SHALL BE SPECIFIED BY ENGINEER OF RECORD.
- B. CONTRACTOR TO PROVIDE EQUIPMENT WITH SUFFICIENT LIFTING AND REACH CAPACITY TO LIFT AND SET THE CDS MANHOLE STRUCTURE.
- C. CONTRACTOR TO INSTALL JOINT SEALANT BETWEEN ALL STRUCTURE SECTIONS AND ASSEMBLE STRUCTURE.
- D. CONTRACTOR TO PROVIDE, INSTALL, AND GROUT INLET AND OUTLET PIPE(S)
- E. CONTRACTOR TO TAKE APPROPRIATE MEASURES TO ASSURE UNIT IS WATER TIGHT, HOLDING WATER TO FLOWLINE INVERT MINIMUM.

CDS-4-C (CDS2015-4) ONLINE CDS STANDARD DETAIL