

CDS-7-C (CDS3535) DESIGN NOTES

STANDARD CDS-7-C (CDS3535) CONFIGURATION.

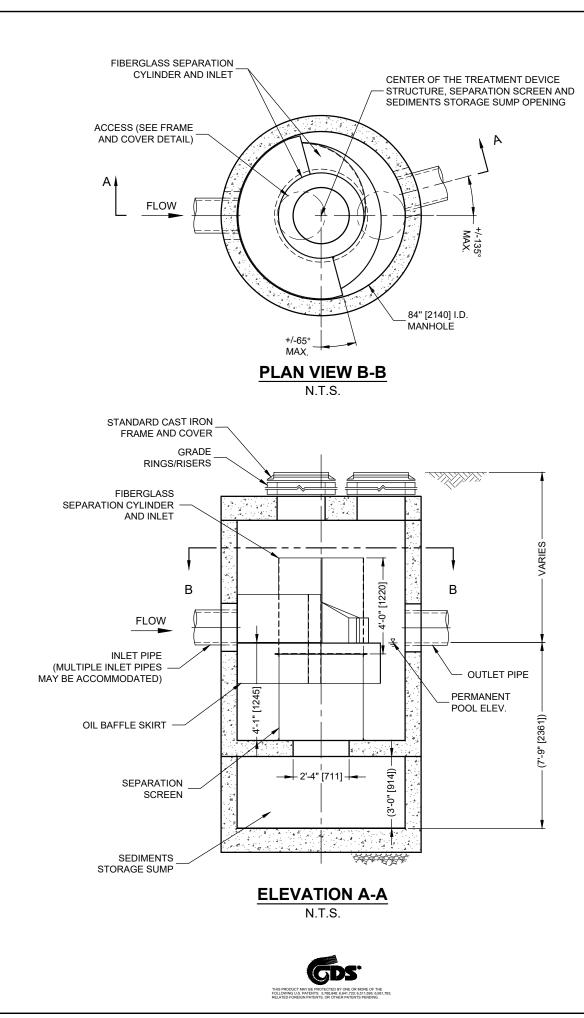



FRAME AND COVER (DIAMETER VARIES) N.T.S.

GENERAL NOTES

- 1. SOLENO TO PROVIDE ALL MATERIALS UNLESS NOTED OTHERWISE.
- CONTRACTOR TO CONFIRM STRUCTURE MEETS REQUIREMENTS OF PROJECT.
- IDENTIFICATION AND THE CONTECH LOGO WILL BE STAMPED ON EACH PART OF THE PRECAST CONCRETE STRUCTURE.
- NECESSARY DURING MAINTENANCE CLEANING.
- 6. CDS STRUCTURE SHALL BE PRECAST CONCRETE CONFORMING TO BNQ3622-420 AND BNQ 1809-300.

INSTALLATION NOTES

- SPECIFIED BY ENGINEER OF RECORD.
- В.
- C.
- CONTRACTOR TO PROVIDE, INSTALL, AND GROUT INLET AND OUTLET PIPE(S). D.
- Ε.



SITE SPECIFIC						
DATA REQUIREMENTS						

STRUCTURE ID						
WATER QUALITY FLOW RATE (L/s)					*	
PEAK FLOW RATE (L/s)					*	
RETURN PERIOD OF PEAK FLOW (YRS)					*	
SCREEN APERTURE (2400)					*	
·						
PIPE DATA:	I.E.	MATERIAL		DIAMETER		
INLET PIPE 1	*	*		*		
INLET PIPE 2	*	*		*		
OUTLET PIPE	*	*		*		
RIM ELEVATION *						
ANTI-FLOTATION BALLAST			WIDTH		HEIGHT	
			*		*	
NOTES/SPECIAL REQUIREMENTS:						
* PER ENGINEER OF RECORD						

2. FOR SITE SPECIFIC DRAWINGS WITH DETAILED STRUCTURE DIMENSIONS AND WEIGHT, PLEASE CONTACT YOUR SOLENO ENGINEER 3. CDS WATER QUALITY STRUCTURE SHALL BE IN ACCORDANCE WITH ALL DESIGN DATA AND INFORMATION CONTAINED IN THIS DRAWING.

4. STRUCTURE SHALL MEET CL-625 LOAD RATING (CAN/CSA-S6), ASSUMING EARTH COVER OF 300 MM (12')', AND GROUNDWATER ELEVATION AT, OR BELOW, THE OUTLET PIPE INVERT ELEVATION. ENGINEER OF RECORD TO CONFIRM ACTUAL GROUNDWATER ELEVATION. BNQ2622-420

5. IF REQUIRED, PVC HYDRAULIC SHEAR PLATE IS PLACED ON SHELF AT BOTTOM OF SCREEN CYLINDER. REMOVE AND REPLACE AS

A. ANY SUB-BASE, BACKFILL DEPTH, AND/OR ANTI-FLOTATION PROVISIONS ARE SITE-SPECIFIC DESIGN CONSIDERATIONS AND SHALL BE

CONTRACTOR TO PROVIDE EQUIPMENT WITH SUFFICIENT LIFTING AND REACH CAPACITY TO LIFT AND SET THE CDS MANHOLE STRUCTURE. CONTRACTOR TO INSTALL JOINT SEALANT BETWEEN ALL STRUCTURE SECTIONS AND ASSEMBLE STRUCTURE.

CONTRACTOR TO TAKE APPROPRIATE MEASURES TO ASSURE UNIT IS WATER TIGHT, HOLDING WATER TO FLOWLINE INVERT MINIMUM.

CDS-7-C (CDS3535) **ONLINE CDS** STANDARD DETAIL